




LEGEND

- 4 X 1.637 MVA INVERTER
- 6.548 MVA TRANSFORMER
- BLOCK OUTLINE
- INVERTER OUTLINE
- PROJECT SITE BOUNDARY
- PROPOSED FENCE
- PROPOSED INTERNAL FENCE
- 20m ASSET PROTECTION ZONE
- 4m INTERNAL ACCESS ROAD
- 6m INTERNAL ACCESS ROAD
- DC TRENCH
- DC PV HARNESS IN U/G
- COMBINER BOX/DISCONNECT SWITCH - SEPARATE PILE TBD
- 15m TREE SHADING SETBACK
- HIGH EROSION AREA

- 4 STRING TRACKER (112 MODULES)
- 3 STRING TRACKER (84 MODULES)

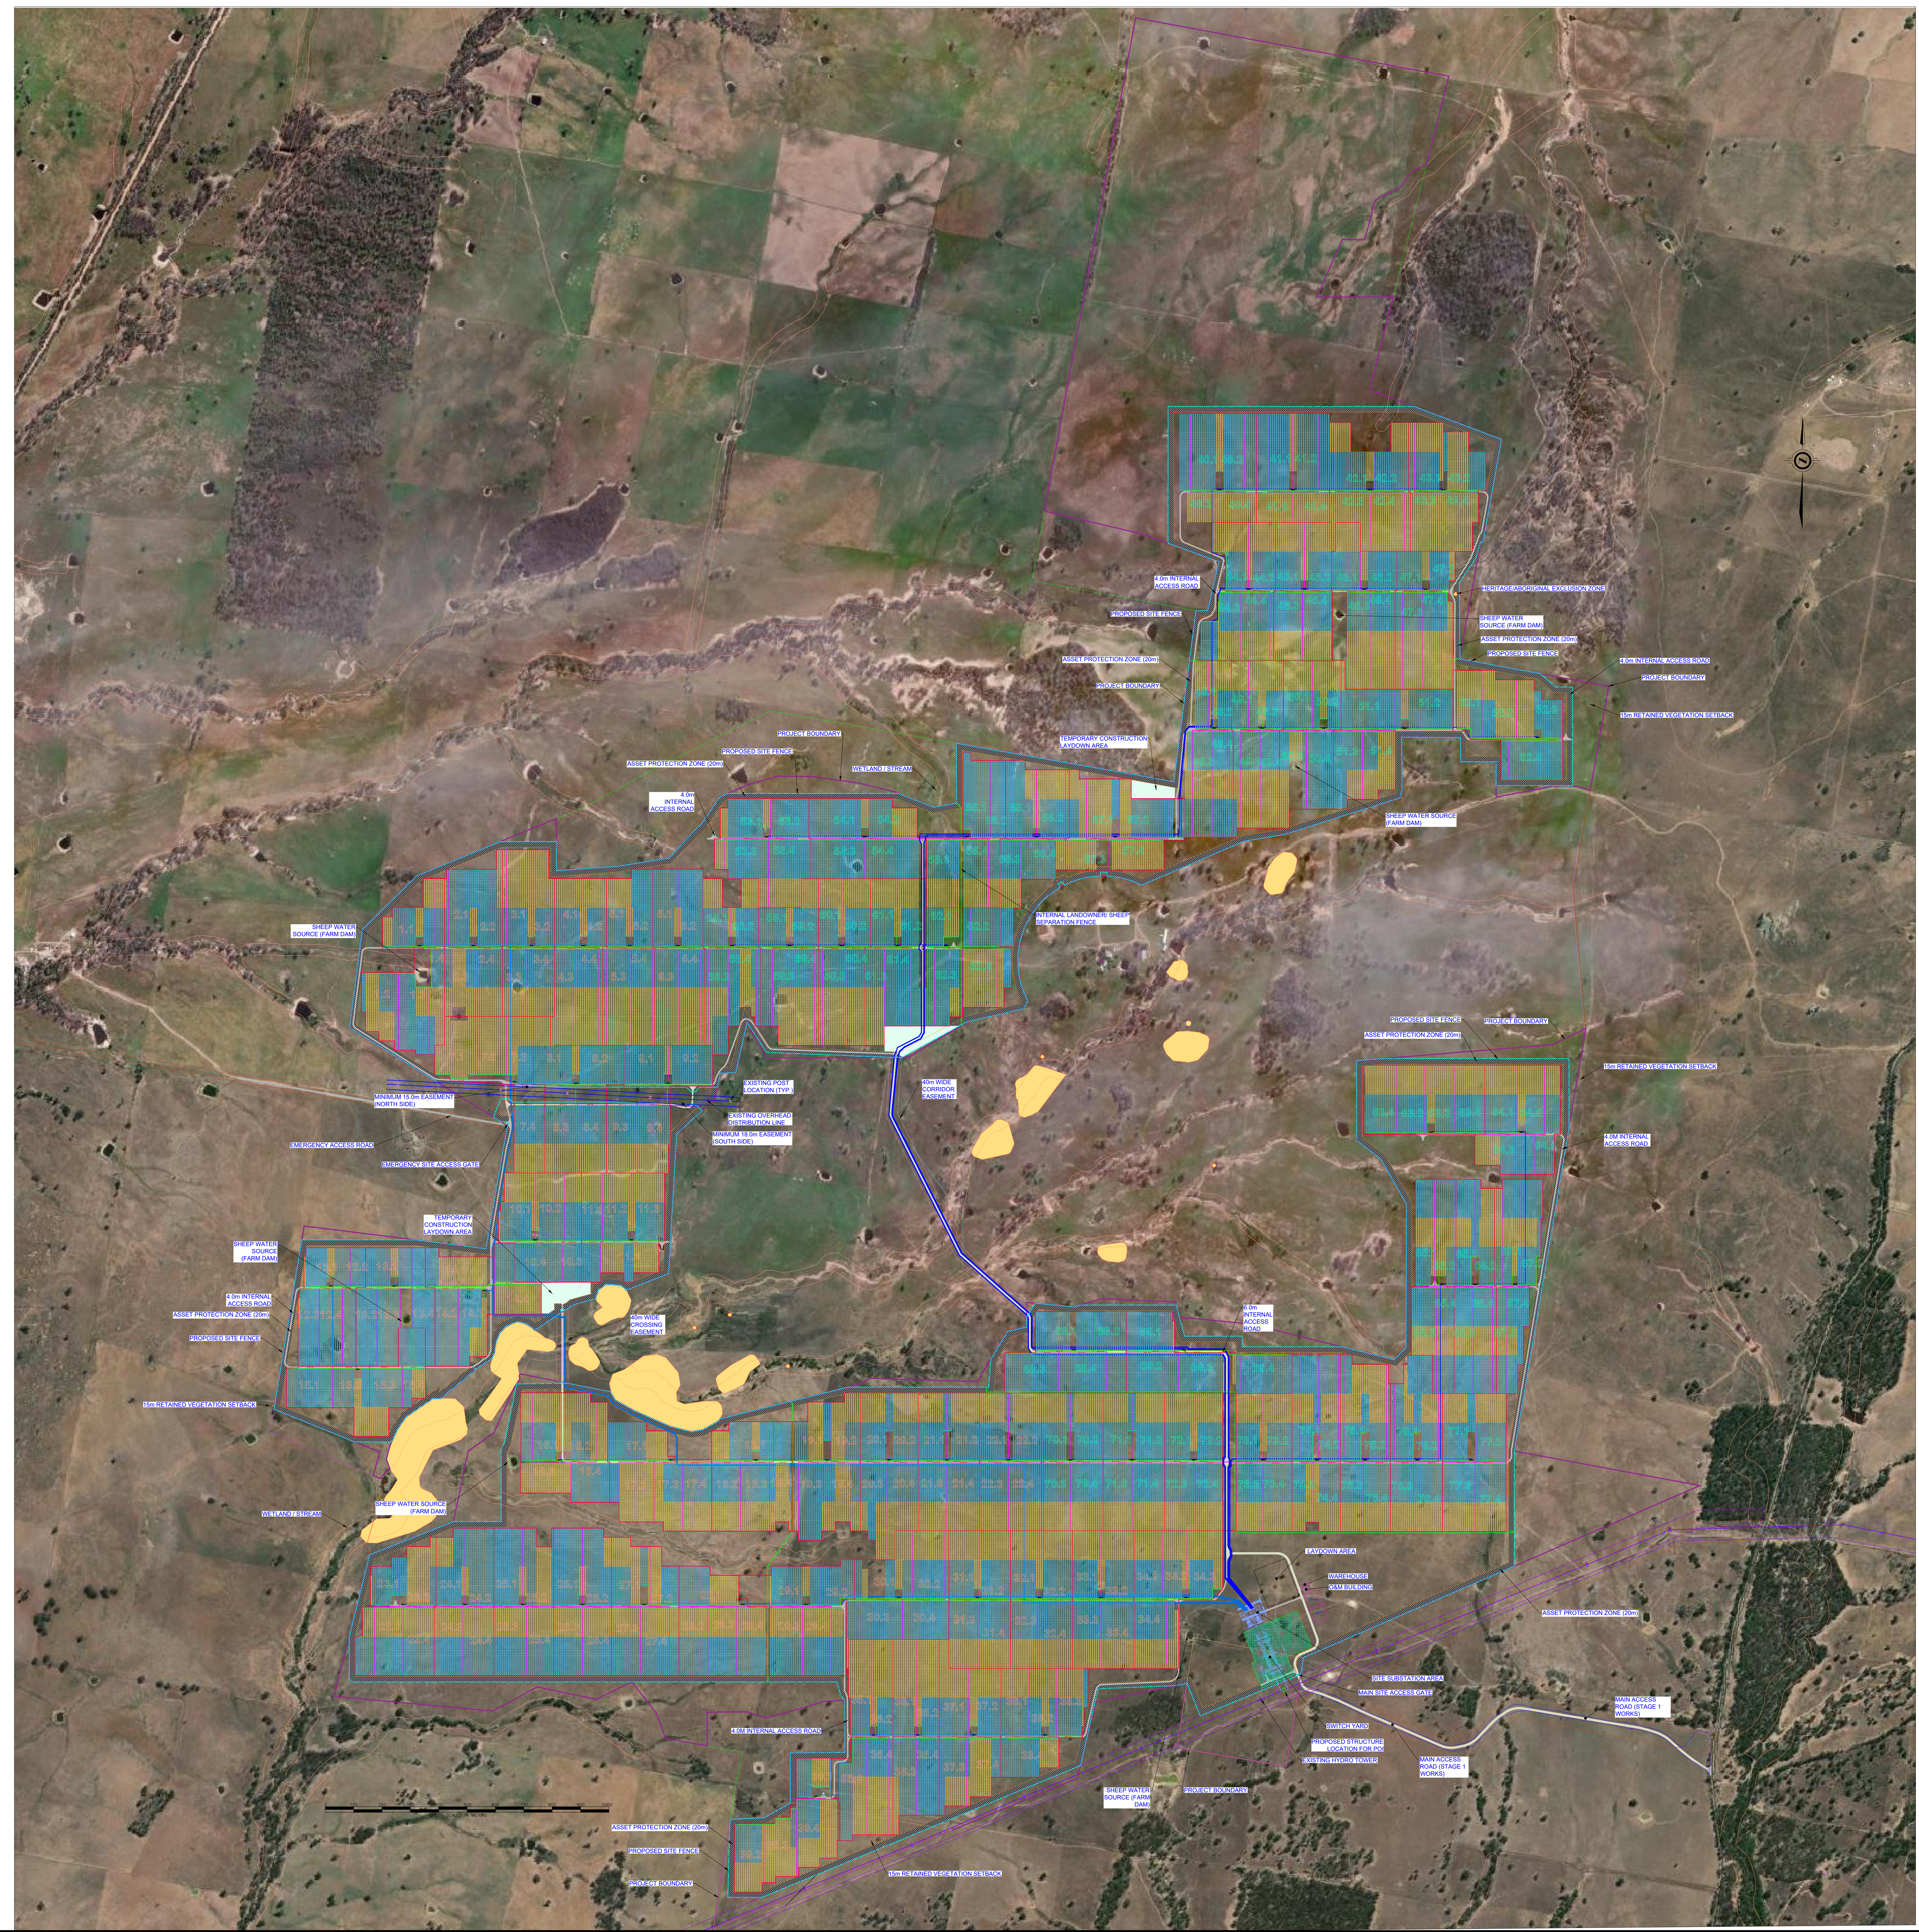

THIS DRAWING IS FOR THE SOLE USE OF ANY PCL OPERATING COMPANY, OR ANY PCL JOINT VENTURE COMPANY. IT IS NOT TO BE USED, ALTERED OR REPRODUCED WITHOUT THE WRITTEN PERMISSION OF THE PCL FAMILY OF COMPANIES.

| | | |
|--------|----------|--|
| 0.2 JS | 5/25/23 | ISSUED FOR FINAL APPROVAL |
| 0.1 AM | 5/09/23 | OH DISTRIBUTION LINE GENERAL LAYOUT FOR REVIEW |
| 0 AM | 5/04/23 | REVISED BLOCK LAYOUT (7,8,9,10,11,12,13,14&15) |
| 8 JS | 2/7/23 | REVISED LAYOUT |
| 7 JS | 1/18/23 | REVISED LAYOUT |
| 6 JS | 1/8/23 | REVISED LAYOUT |
| 5 JS | 12/7/22 | REVISED LAYOUT |
| 4 JS | 12/2/22 | REVISED LAYOUT |
| 3 JS | 11/18/22 | ISSUED FOR REVIEW |

Plot Scale: As Shown Date: May 25, 2023
 Drawn By: J.S. Checked By:

Sheet Title: Stubbo Solar Project Site Stage 2A Final Layout (400MWAC)

Drawing No.: DWG-100